WILD BLUE GROUP LLC 8090 RUNNING VALLEY RD, STROUDSBURG PA 18360
(570) 801-1300

LIMITED AIR QUALITY ASSESSMENT

TEST LOCATION:

825 HOMESTEAD DR

DALLAS, PA 18612

COLLECTED: WEDNESDAY 24 SEPTEMBER 2025

RECEIVED: 24 SEPTEMBER 2025

REPORTED: 24 SEPTEMBER 2025

APPROVED BY:
Thom Schiavone CPI
Project Manager

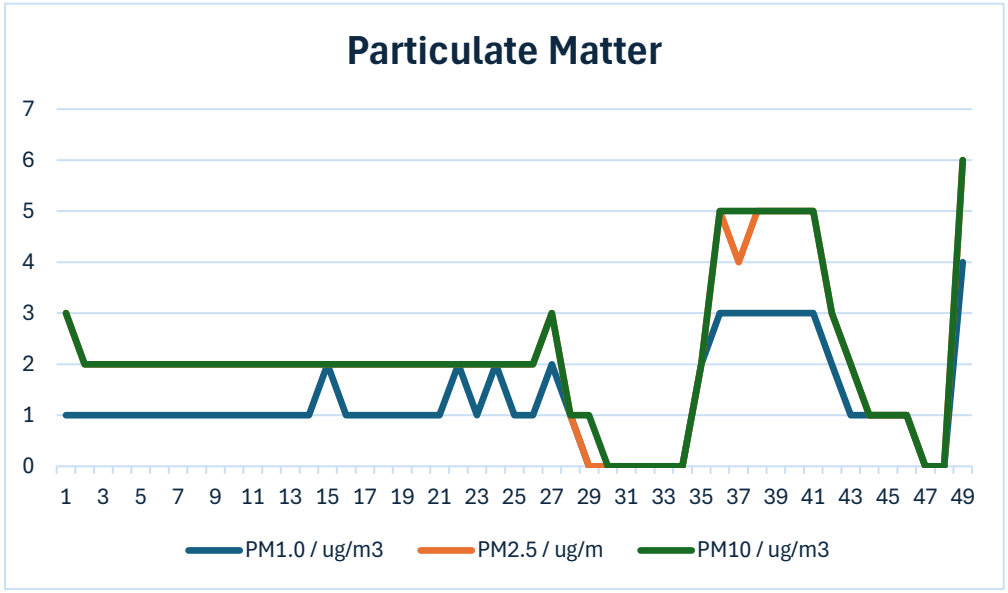
Digitally signed by Thom Schiavone
DN: cn=Thom Schiavone, o=Wild Blue Group LLC, ou=WBG HQ, email=thom@wildbluegroup.com, c=US
Date: 2025.09.24 17:18:58 -04'00'

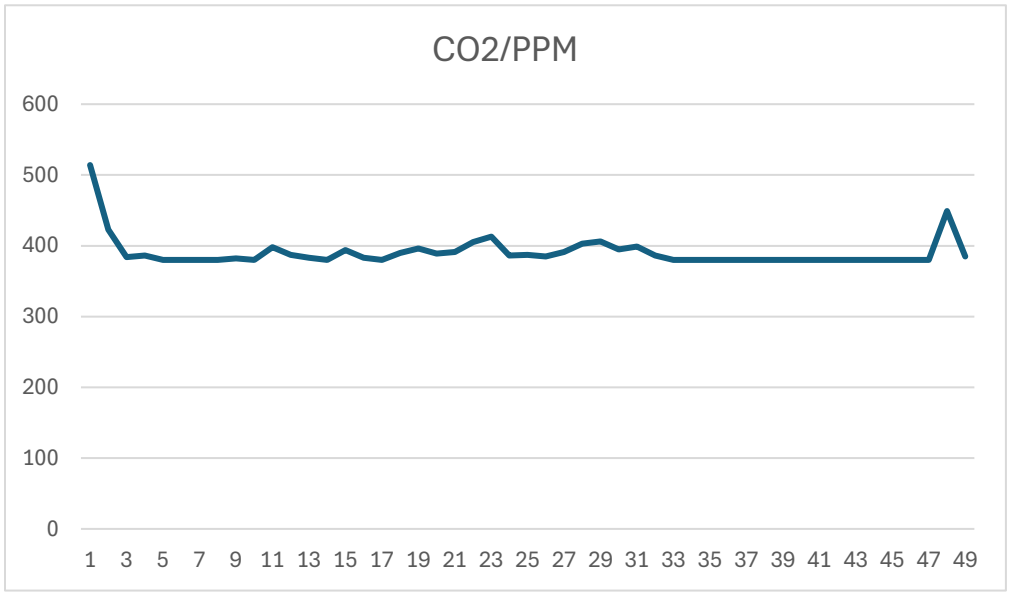
VERSION: 1.0 (A VERSION NUMBER GREATER THAN ONE (1) INDICATES THAT THE DATA IN THIS REPORT HAS BEEN AMENDED)

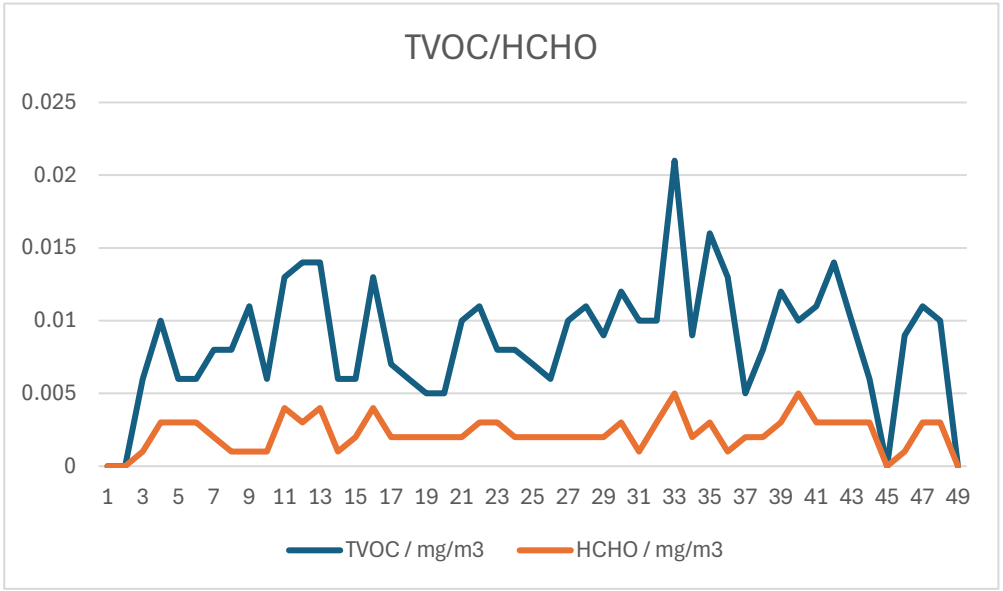
DATE/TIME	PM1.0 / ug/m3	PM2.5 / ug/m	PM10 / ug/m3	Co2 / PPM	TVOC / mg/m3	HCHO / mg/m3	Temp	Hum	PM 2.5 Avg	PM10 Avg	PM1.0 Avg	Co2 Avg	TVOC Avg	HCHO Avg	Avg Temp	Avg Hum
									2.08	2.12	1.27	390.82	0.99	0.00	73.45	0.55%

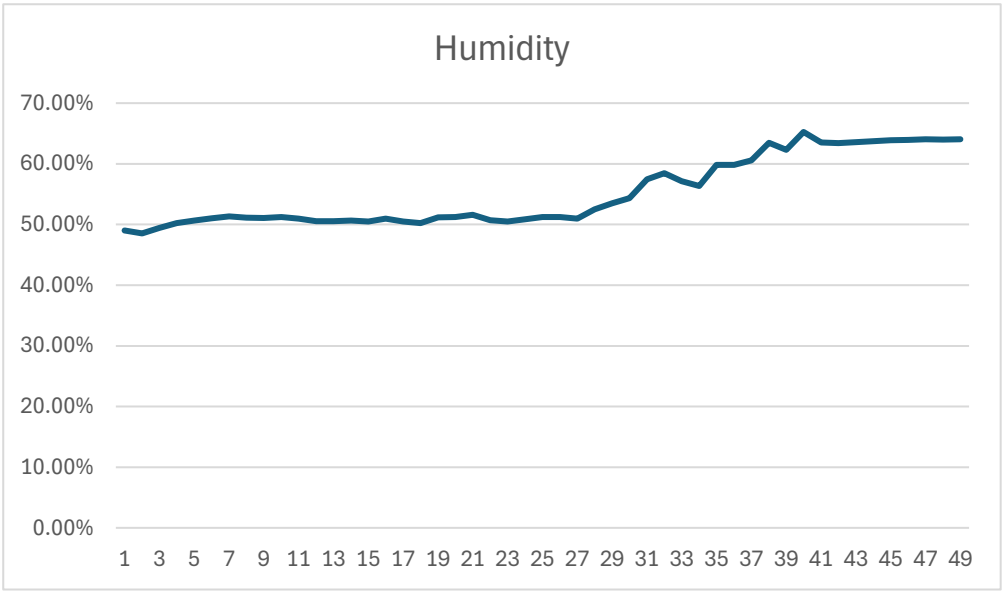
Column1	Column2	Column3	Column4	Column5	Column6	Column7	Column8	Column9
2025-09-24/12:43:44	1	3	3	514	0	0	73.02	49.04%
2025-09-24/12:44:44	1	2	2	423	0	0	72.72	48.53%
2025-09-24/12:45:44	1	2	2	384	0.006	0.001	72.05	49.43%
2025-09-24/12:46:44	1	2	2	386	0.01	0.003	71.6	50.21%
2025-09-24/12:47:44	1	2	2	380	0.006	0.003	71.24	50.65%
2025-09-24/12:48:44	1	2	2	380	0.006	0.003	71.08	51.00%
2025-09-24/12:49:44	1	2	2	380	0.008	0.002	70.95	51.34%
2025-09-24/12:50:44	1	2	2	380	0.008	0.001	70.99	51.12%
2025-09-24/12:51:44	1	2	2	382	0.011	0.001	70.99	51.05%
2025-09-24/12:52:44	1	2	2	380	0.006	0.001	71.01	51.23%
2025-09-24/12:53:44	1	2	2	398	0.013	0.004	71.17	50.99%
2025-09-24/12:54:44	1	2	2	387	0.014	0.003	71.28	50.52%
2025-09-24/12:55:44	1	2	2	383	0.014	0.004	71.35	50.54%
2025-09-24/12:56:44	1	2	2	380	0.006	0.001	71.35	50.63%
2025-09-24/12:57:44	2	2	2	394	0.006	0.002	71.42	50.51%
2025-09-24/12:58:44	1	2	2	383	0.013	0.004	71.4	50.94%
2025-09-24/12:59:44	1	2	2	380	0.007	0.002	71.4	50.47%
2025-09-24/13:00:44	1	2	2	390	0.006	0.002	71.4	50.25%
2025-09-24/13:01:44	1	2	2	396	0.005	0.002	71.46	51.20%
2025-09-24/13:02:44	1	2	2	389	0.005	0.002	71.53	51.24%
2025-09-24/13:03:44	1	2	2	391	0.01	0.002	71.53	51.58%
2025-09-24/13:04:44	2	2	2	405	0.011	0.003	71.87	50.72%
2025-09-24/13:05:44	1	2	2	413	0.008	0.003	71.58	50.51%
2025-09-24/13:06:44	2	2	2	386	0.008	0.002	71.31	50.87%
2025-09-24/13:07:44	1	2	2	387	0.007	0.002	71.24	51.23%
2025-09-24/13:08:44	1	2	2	385	0.006	0.002	71.29	51.22%
2025-09-24/13:09:44	2	3	3	391	0.01	0.002	71.35	50.95%
2025-09-24/13:10:44	1	1	1	403	0.011	0.002	71.78	52.48%
2025-09-24/13:11:44	0	0	1	406	0.009	0.002	72.14	53.50%
2025-09-24/13:12:44	0	0	0	395	0.012	0.003	72.41	54.32%
2025-09-24/13:13:44	0	0	0	399	0.01	0.001	72.72	57.44%

2025-09-24/13:14:44	0	0	0	386	0.01	0.003	73.51	58.46%
2025-09-24/13:15:44	0	0	0	380	0.021	0.005	74.41	57.15%
2025-09-24/13:16:44	0	0	0	380	0.009	0.002	75.22	56.32%
2025-09-24/13:17:44	2	2	2	380	0.016	0.003	75.74	59.82%
2025-09-24/13:18:44	3	5	5	380	0.013	0.001	76.17	59.81%
2025-09-24/13:19:44	3	4	5	380	0.005	0.002	76.35	60.56%
2025-09-24/13:20:44	3	5	5	380	0.008	0.002	76.48	63.45%
2025-09-24/13:21:44	3	5	5	380	0.012	0.003	76.6	62.32%
2025-09-24/13:22:44	3	5	5	380	0.01	0.005	76.78	65.25%
2025-09-24/13:23:44	3	5	5	380	0.011	0.003	76.84	63.52%
2025-09-24/13:24:44	2	3	3	380	0.014	0.003	77.07	63.42%
2025-09-24/13:25:44	1	2	2	380	0.01	0.003	77.25	63.57%
2025-09-24/13:26:44	1	1	1	380	0.006	0.003	77.45	63.71%
2025-09-24/13:27:44	1	1	1	380	0	0	77.63	63.87%
2025-09-24/13:28:44	1	1	1	380	0.009	0.001	77.92	63.96%
2025-09-24/13:29:44	0	0	0	380	0.011	0.003	78.17	64.02%
2025-09-24/13:30:44	0	0	0	449	0.01	0.003	78.42	63.97%
2025-09-24/13:31:44	4	6	6	385	0	0	78.62	64.05%
Subtotal	62	102	104	19150	0.427	0.11	3599.3	27.029
Count	49	49	49	49	49	49	49	49
Average	1.27	2.08	2.12	390.82	0.99	0.00	73.45	0.55%


Particulate Matter
7
6
5
4
3
2
1
0
1 3 5 7 9 11 13 15 17 19 21 23 25 27 29 31 33 35 37 39 41 43 45 47 49
PM1.0 / ug/m3
PM2.5 / ug/m
PM10 / ug/m3


CO2/PPM
600
500
400
300
200
100
0
1 3 5 7 9 11 13 15 17 19 21 23 25 27 29 31 33 35 37 39 41 43 45 47 49


TVOC/HCHO
0.025
0.02
0.015
0.01
0.005
0
1 3 5 7 9 11 13 15 17 19 21 23 25 27 29 31 33 35 37 39 41 43 45 47 49
TVOC / mg/m3
HCHO / mg/m3


Humidity
70.00%
60.00%
50.00%
40.00%
30.00%
20.00%
10.00%
0.00%
1 3 5 7 9 11 13 15 17 19 21 23 25 27 29 31 33 35 37 39 41 43 45 47 49